

CHINA QUALITY CERTIFICATION CENTRE CO., LTD. CERTIFICATE OF CONFORMITY

Certificate No.: CE240306008891

Product Automatic transfer switch

Applicant Zhejiang Tengen Electric Co.,Ltd.
Sulv Industrial Area, Liushi Town, Yueqing City, Zhejiang
Province, P.R.China

Type/Model TGQ3L-400、TGQ3PL-630;

Technical data SEE ATTACHMENT

This is to certify that, on the basis of the tests undertaken as per Report No. CE-045-1CE240003, the submitted sample(s) of the above item complies with:

EN 60947-6-1:2005 + A1:2014

and fulfills testing requirements of the European Directive:

2014/35/EU

This report is to verify the compliance of the sample submitted by the manufacturer only, and does not include the manufacturing process. Users shall affix the mark in accordance with the related legislation.

Valid from: May.23,2024

Valid until: May.22,2027

The certificate information is available through the QR code below or CNCA's website: www.cnca.gov.cn



SIGNATURE:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE



CHINA QUALITY CERTIFICATION CENTRE CO., LTD. CERTIFICATE OF CONFORMITY


Appendix

Page 1 of 1

Certificate No.: CE240306008891

TGQ3L-400;Ui:800V;Uimp:8kV(main),2.5kV
(subsidiary,control);Ith:400A;Ue:AC400V/415V;Ie:250A,315A,350A,400A;Utilization
category:AC-33A;Iq:120kA;Class of equipment:PC;Method of controlling:ATSE;Pole:3P,4P;
50Hz/60Hz

TGQ3L-630;Ui:800V;Uimp:8kV(main),2.5kV(subsidiary,control);
Ith:630A;Ue:AC400V/415V;Ie:250A,315A,350A,400A,500A,630A;Utilization
category:AC-33iA,AC-33B;Iq:120kA;
Class of equipment:PC;Method of controlling:ATSE;Pole: 3P,4P;50Hz/60Hz

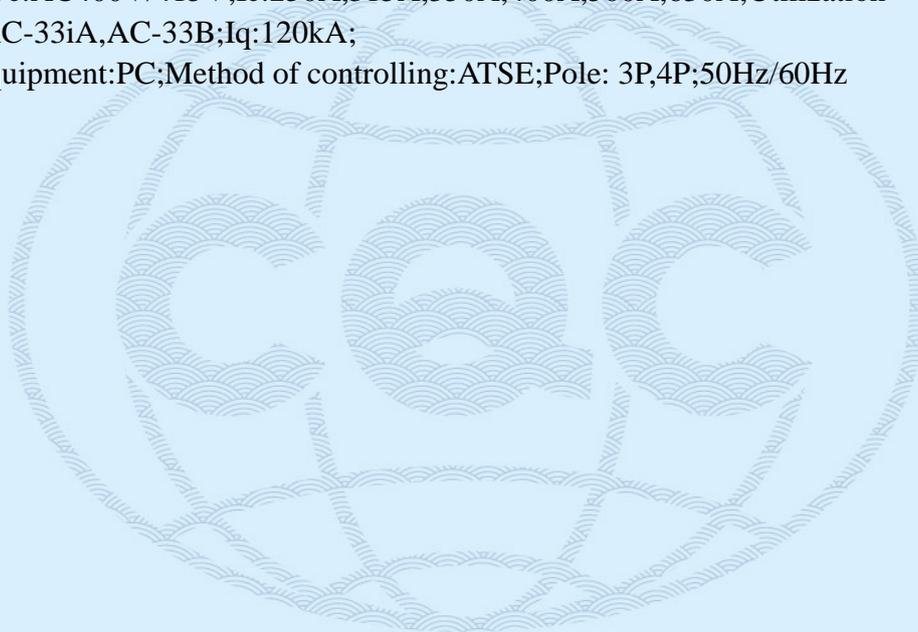

中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE